


FLANGE DIAHRAGM VALVE

Working Temperature: 1. Medium -20℃~+150 ℃
 2.Ambient -20℃~+60 ℃
 Control Gas Type: Neutral Gas,Air.
 Air Supply Pressure: 0.3~0.8MPa.

MAIN PARTS OF CONSTRUCTION

NO.	PART NAME	MATERIAL
1	BODY	SS316
2	DIAPHRAGM	EPDM
3	STEM	20Cr13+Electrolysis
4	SEALING O-RING	NBR
5	ACTUATOR	ADC12

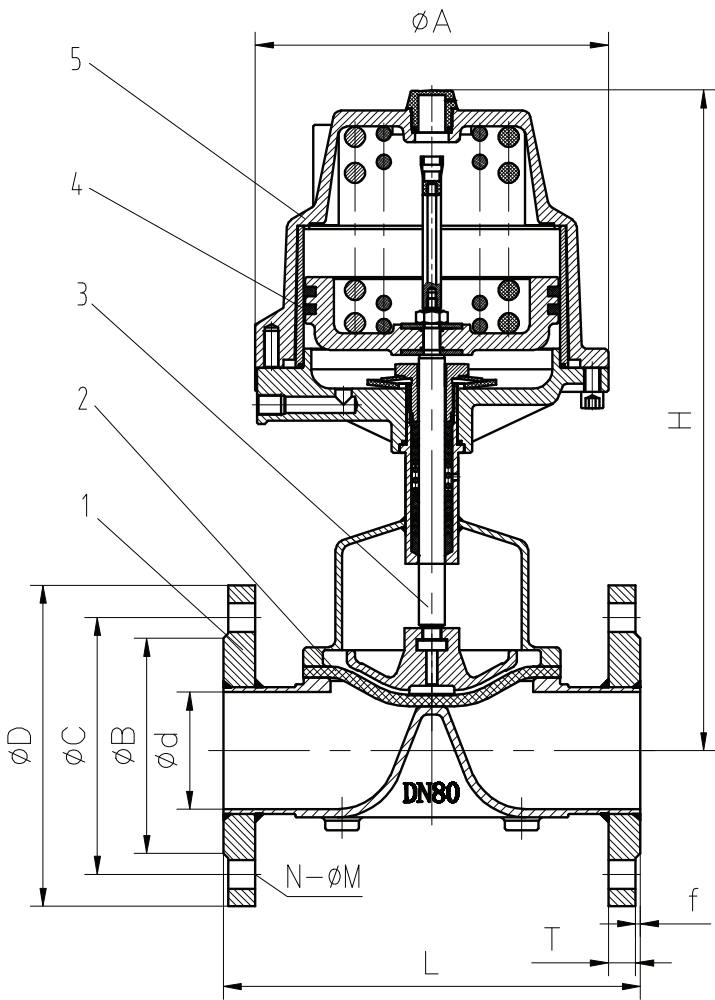

TEST PRESSURE

Shell Hydrostatic	Seat Hydrostatic	Air Test
MPa	1.5	1.1
		0.6

CONFIGURATION DIMENSION

MODEL	L	d	D	C	B	T	f	N-M	A	H	ACTUATOR	WEIGHT(KG)
DN80	254	73	190	152.4	127	17.5	2	4-19	220	411	$\phi 160$	